


STANDARD INSTALLATION (UP TO 2 DEVICES)




NOTES

- 1). PEDESTAL SHALL BE USED WHEN ALL DEVICES ARE AWAY FROM POWER SOURCE.
- 2). ALL CONDUITS AND OTHER ASSOCIATED PIECES SHALL BE 2" RIGID GALVANIZED CONDUIT UNLESS SPECIFIED DIFFERENTLY ON THE PLANS OR BY LOCAL UTILITY COMPANY. ALL CONDUITS SHALL BE INSTALLED FROM ENCLOSURE TO TYPE 1 JUNCTION WELL. JUNCTION WELL SHALL BE PLACED WITHIN 10' OF SERVICE PEDESTAL (OR PER PLAN).

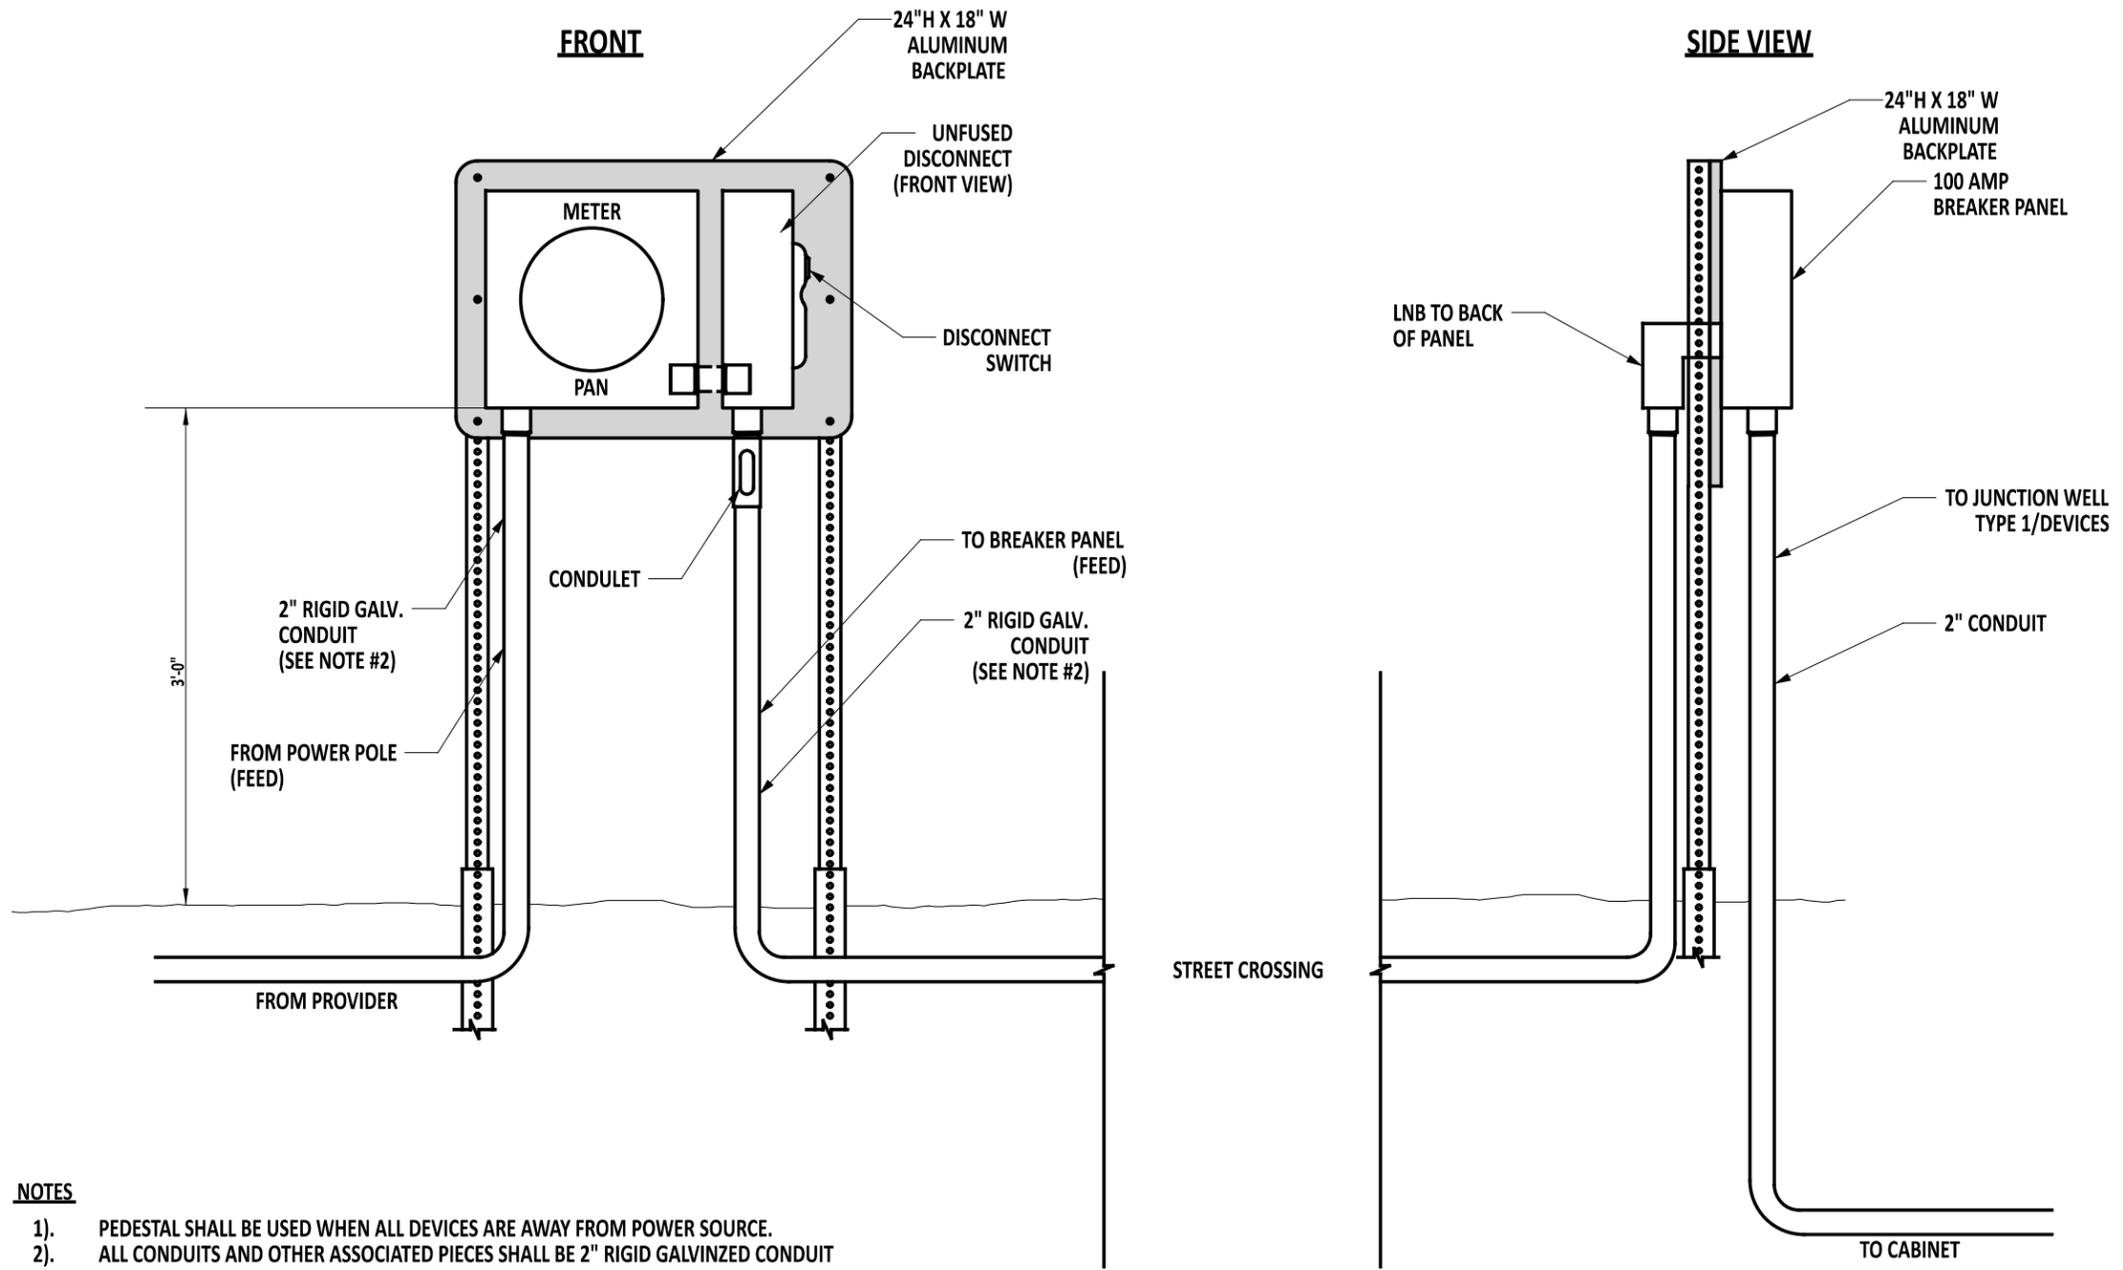


 ENGINEERING SUPPORT DATE 09/01/2020
RECOMMENDED

ELECTRICAL SERVICE PEDESTAL -
SIGNAL & ITS COMPONENT INSTALLATIONS - 100 AMP (UP TO 2 DEVICES)
 STANDARD NO. T-17 (2020) SHT. 3 OF 5

REVIEWED 
 DEPUTY DIRECTOR - DESIGN DATE 09/01/2020
 APPROVED 
 CHIEF ENGINEER DATE 09/01/2020